


- NOTES:
1. TERMINATION BAR TERMINATION MUST BE ABOVE THE MAXIMUM WATER LEVEL.
 2. A MINIMUM OF 2 FASTENERS ARE REQUIRED IN EACH PIECE OF TERMINATION BAR OR 12" (304.8 MM) O.C.
 3. SURFACE MOUNTED COUNTERFLASHING IS INSTALLED IN A SIMILAR FASHION.

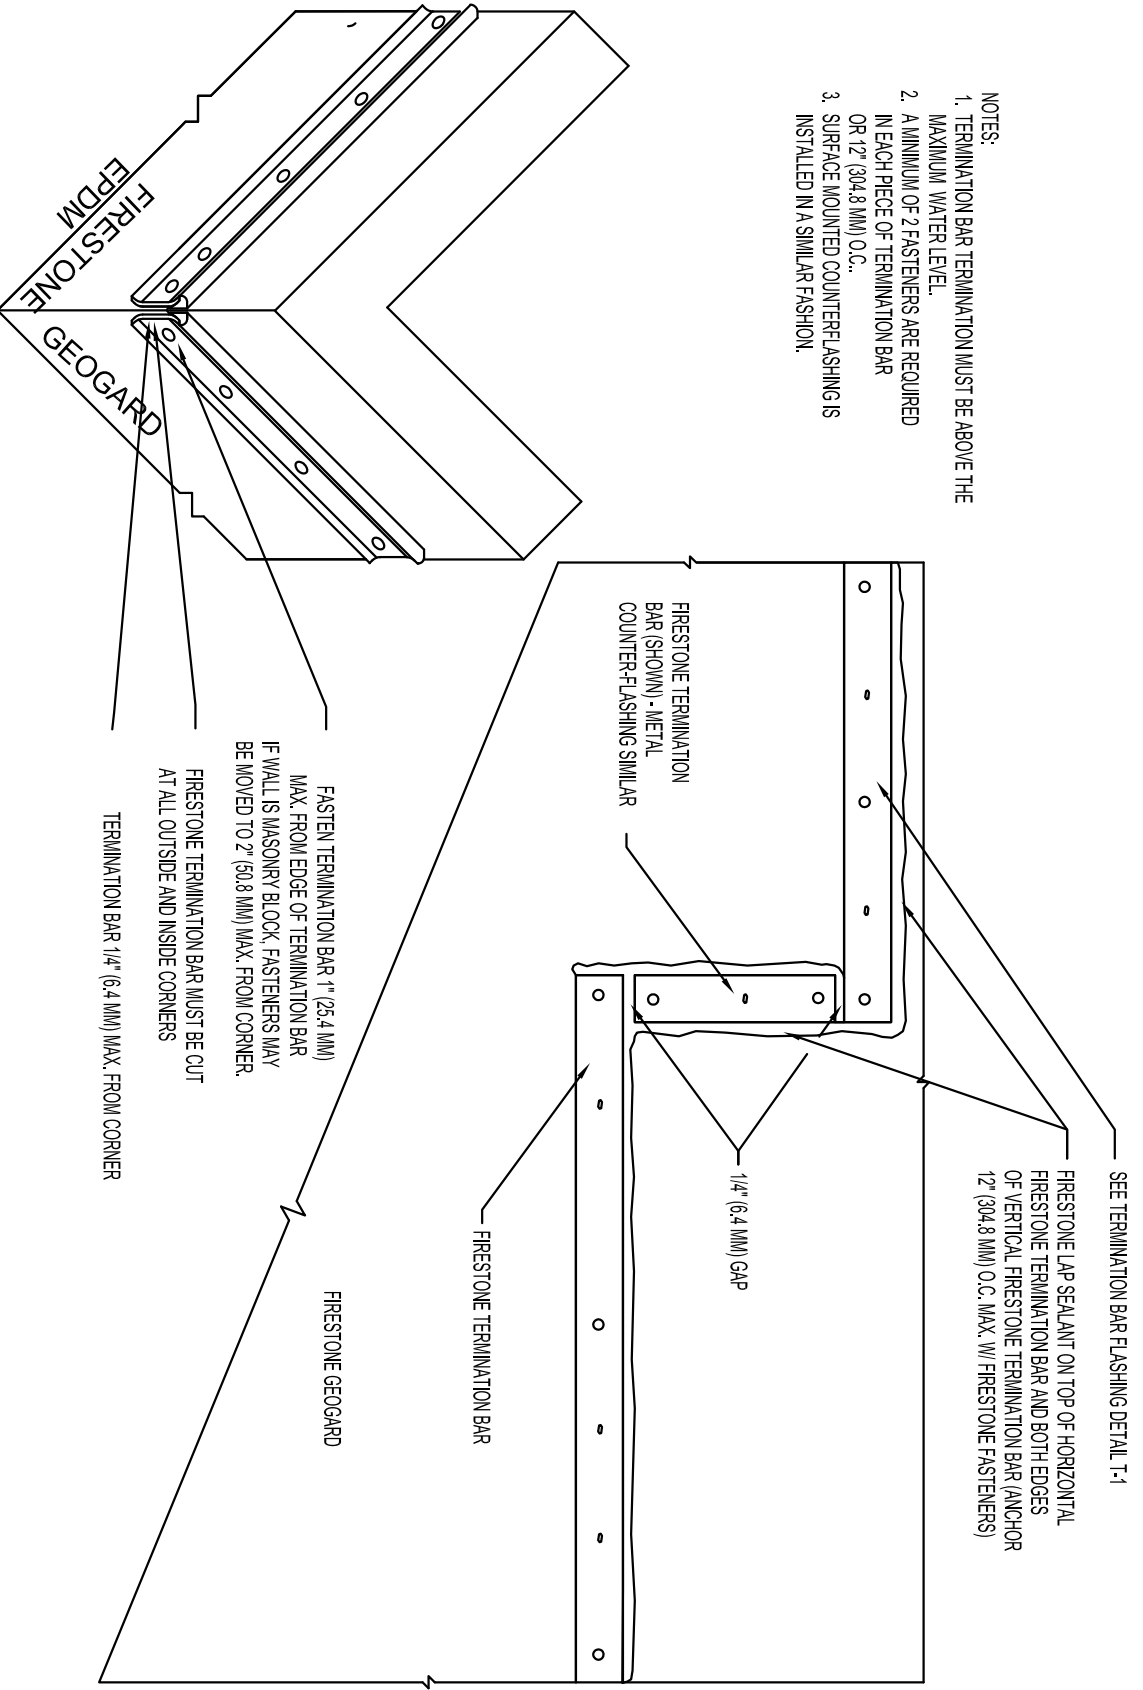

FASTEN TERMINATION BAR 1/4" (25.4 MM) MAX. FROM EDGE OF TERMINATION BAR
 IF WALL IS MASONRY BLOCK, FASTENERS MAY BE MOVED TO 2" (50.8 MM) MAX. FROM CORNER.

FIRESTONE TERMINATION BAR MUST BE CUT AT ALL OUTSIDE AND INSIDE CORNERS

TERMINATION BAR 1/4" (6.4 MM) MAX. FROM CORNER

SEE TERMINATION BAR FLASHING DETAIL T-1

FIRESTONE LAP SEALANT ON TOP OF HORIZONTAL FIRESTONE TERMINATION BAR AND BOTH EDGES OF VERTICAL FIRESTONE TERMINATION BAR (ANCHOR 12" (304.8 MM) O.C. MAX. W/ FIRESTONE FASTENERS)

MAXIMUM WARRANTY: **N/A**

Termination Step Down & Outside Corner Above Max. Water Line



ACCEPTABLE SYSTEMS:	
GEOGARD™	EPDM, EPDM-R, ECOWHITE EPDM

ISSUE / REVISION DATE:	7-30-2015
NOT TO SCALE	

DETAIL NO.	T-3
------------	------------