


- NOTES:**
1. TERMINATION BAR TERMINATION MUST BE ABOVE THE MAXIMUM WATER LEVEL.
  2. A MINIMUM OF 2 FASTENERS ARE REQUIRED IN EACH PIECE OF TERMINATION BAR OR 12" (304.8 MM) O.C..
  3. GEOMEMBRANE AND LINER ARE INTERCHANGEABLE TERMS.

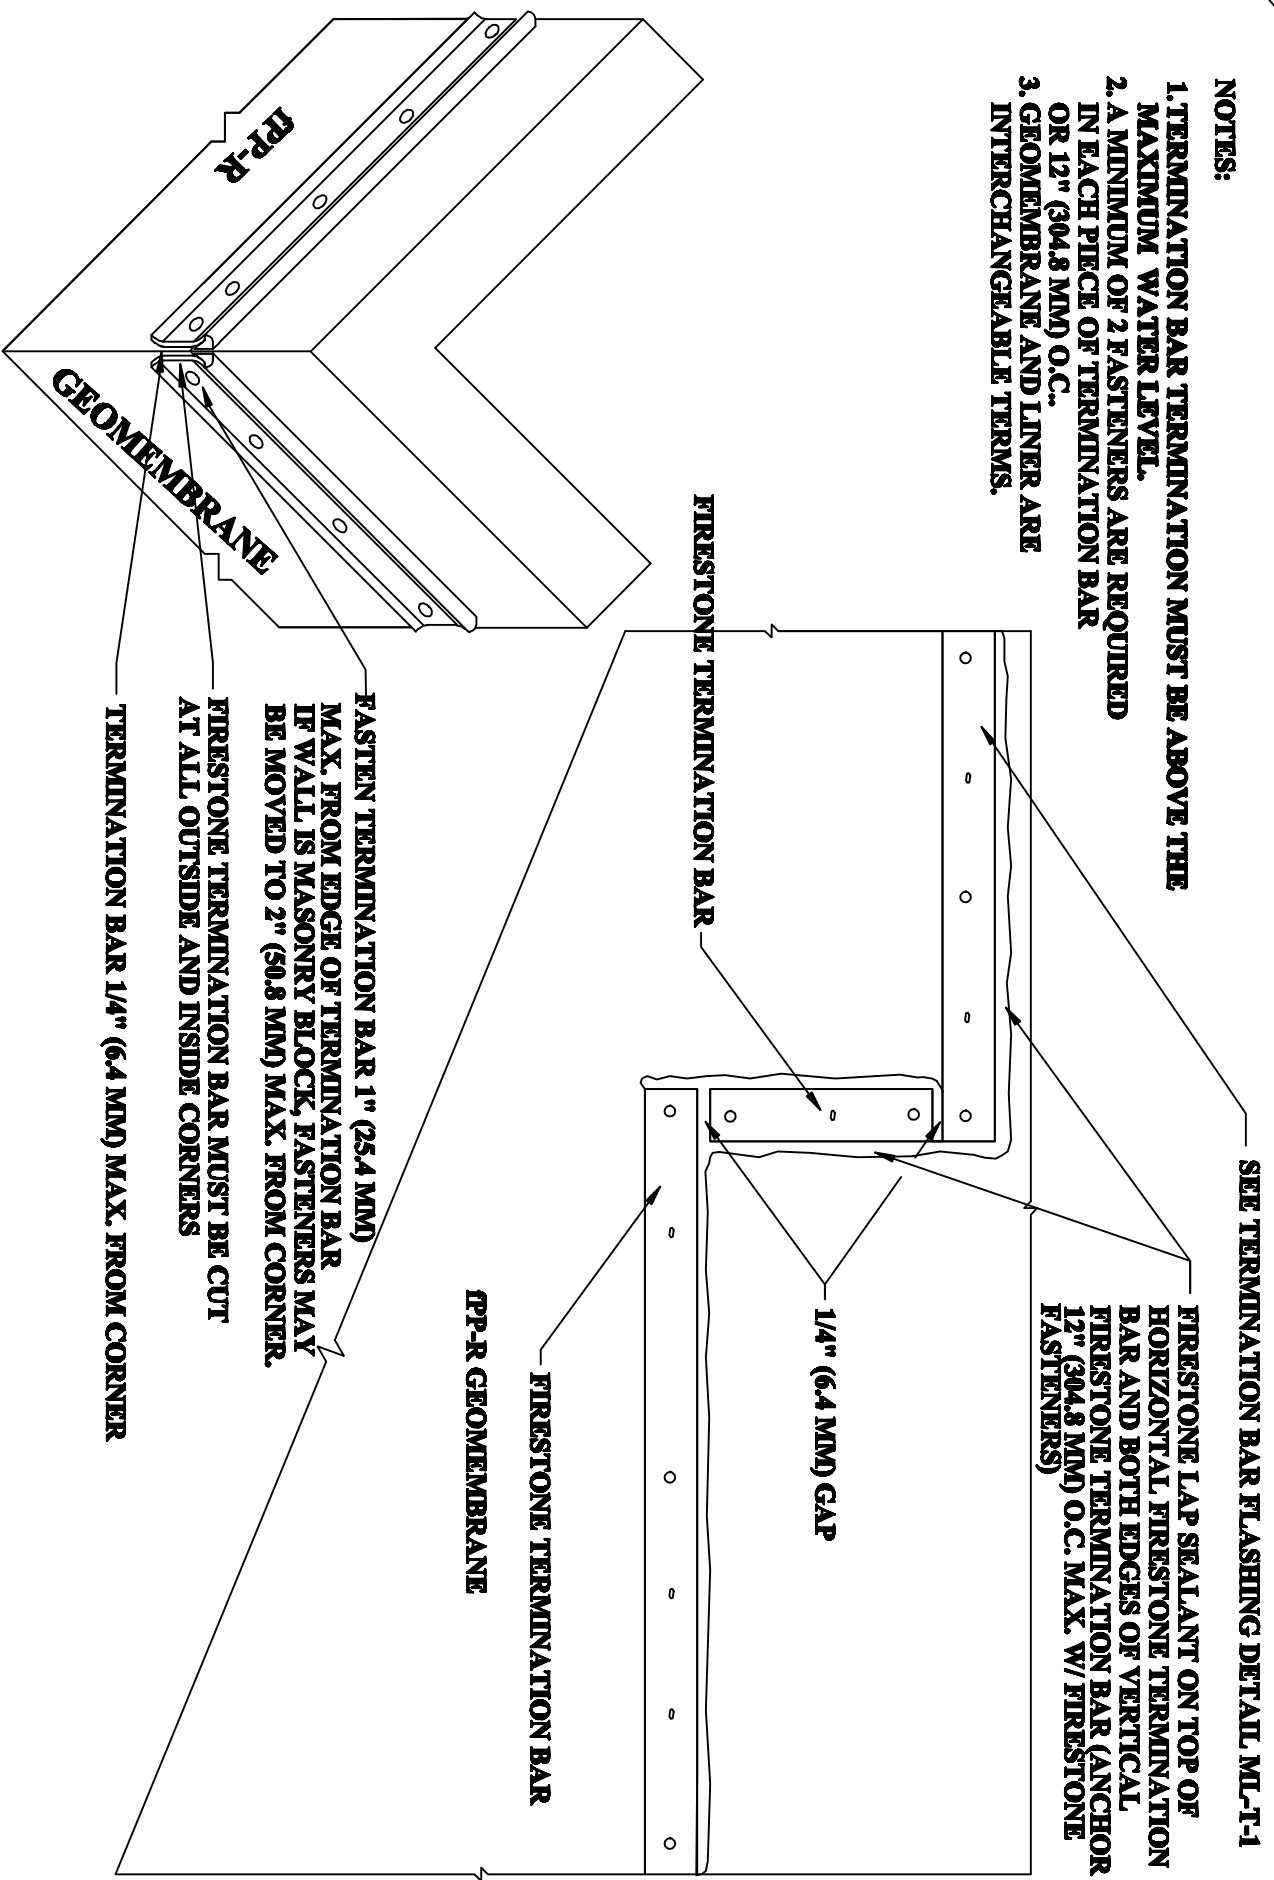

**FASTEN TERMINATION BAR 1" (25.4 MM) MAX. FROM EDGE OF TERMINATION BAR IF WALL IS MASONRY BLOCK, FASTENERS MAY BE MOVED TO 2" (50.8 MM) MAX. FROM CORNER.**

**FIRESTONE TERMINATION BAR MUST BE CUT AT ALL OUTSIDE AND INSIDE CORNERS**

**TERMINATION BAR 1/4" (6.4 MM) MAX. FROM CORNER**

<h1 style="margin: 0;">Firestone</h1> <p style="margin: 0; font-size: small;">20 Geomembranes that Work 09</p>	<b>FP-R Geomembrane</b> Term. Step Down & Outside Corner Above Max. Water Line	<b>Detail No.</b> ML-T-3 <b>Systems</b> Polypropylene
	<p style="font-size: x-small;">SEE TERMINATION BAR FLASHING DETAIL ML-T-1</p>	