


MECHANICALLY ATTACHED RUBBERGARD LS-FR OR RUBBERGARD PLATINUM OVER FIRESTONE ISO 95+ GL 22 to 16 ga, 33 KSI, STEEL DECK (MAX SPAN 72")

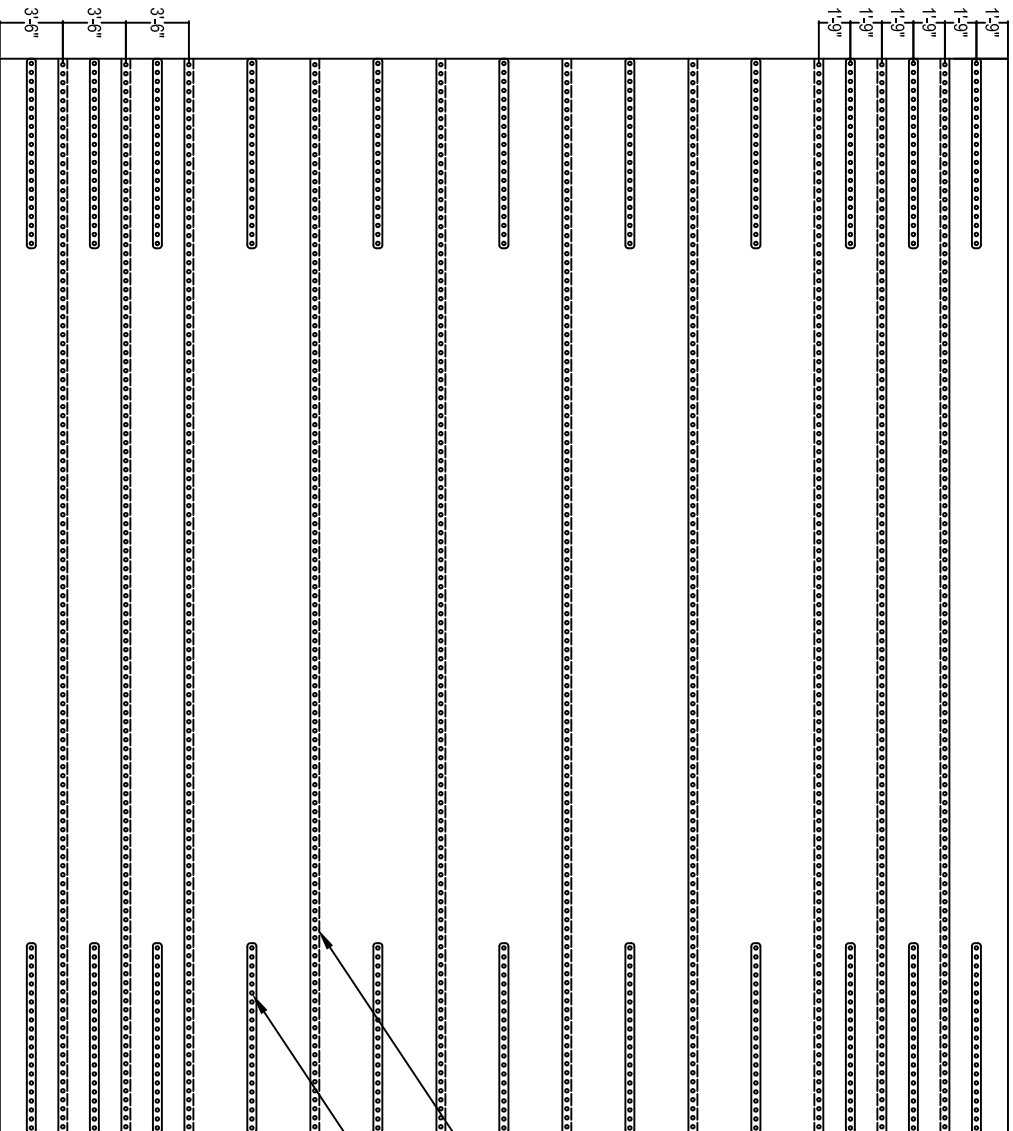

- NOTES:
1. INSTALL FASTENER ROWS AND/OR BATTEN BARS PERPENDICULAR TO THE ROOF DECK RIBS. PLEASE REFER TO SECTION 2.2.7.3 IN FM 1-29 REGARDING MECHANICALLY ATTACHED SINGLE-PLY MEMBRANES AND MULTIPLE COVERS WITH MECHANICALLY ATTACHED BASE PILES.
 2. PLEASE REFER TO FM 1-29 FOR SPECIFIC ATTACHMENTS. DECKS MUST BE ATTACHED PER FACTORY MUTUAL TO OBTAIN A FACTORY MUTUAL RATING.
 3. IF THE PROJECT IS FACTORY MUTUAL INSURED, PLEASE CONTACT THE LOCAL FACTORY MUTUAL REPRESENTATIVE.
 4. IN HURRICANE PRONE AREAS, FACTORY MUTUAL RECOMMENDS USING A MIN. .080" THICK MEMBRANE.
 5. PLEASE VISIT THE FIRESTONE WEBSITE AT [HTTP://FIRESTONEBPC.COM](http://firestonebpc.com) FOR ADDITIONAL INFORMATION.
 6. PLEASE REFER TO FM 1-29 FOR PERIMETER AND CORNER ENHANCEMENT REQUIREMENTS. THE PERIMETER AND CORNER ZONES ARE CALCULATED BY USING 1 TIMES THE LESSER PLAN DIMENSION OR .4 TIMES THE BUILDING HEIGHT, AND NEVER LESS THAN 3' (914 mm) (10' (3048 mm) PERIMETER SHOWN FOR EXAMPLE ONLY. ACTUAL PERIMETER AND CORNER ZONES MUST BE CALCULATED ON A JOB TO JOB BASIS.)

7-6" SHEET MAX

4"-0" SHEET MAX

FIRESTONE HEAVY DUTY FASTENER WITH FIRESTONE POLYMER BATTEN STRIP OR FIRESTONE COILED METAL BATTEN STRIP FASTENED AT 6" (305 mm) O.C. MEMBRANE SEAMS 6" (152 mm) WIDE USING QUICKSEAM SPLICE TAPE CENTERED OVER THE FASTENER

QUICKSEAM BATTEN COVER MIN. 6" (152 mm) ON TOP OF MEMBRANE OR QUICKSEAM R.M.A. UNDER THE MEMBRANE

<p style="font-size: small; margin-top: 5px;">NOBODY COVERS YOU BETTER.™ www.firestonebpc.com</p>	<h2 style="margin: 0;">RUBBERGARD EPDM 84" ROW SPACING AT 6" O.C.</h2>		<p style="font-size: x-large; margin: 0;">DETAIL NO.</p> <h1 style="margin: 0;">FM 1-60</h1>
	RUBBERGARD™ EPDM	ACCEPTABLE SYSTEMS: MAS	